

REPORT OF DRINKING WATER SAMPLING FOR LEAD CONTENT AT:

**ADMINISTRATION CENTER
280 INTERSTATE DR.
WENTZVILLE, MISSOURI 63385**



PREPARED FOR:

**MRS. ANGELA HAWKINS
DIRECTOR OF FACILITIES/SAFETY COORDINATOR
WENTZVILLE R-IV SCHOOL DISTRICT
101 SUPPORT SERVICE DRIVE
WENTZVILLE, MISSOURI 63385**

PREPARED BY:

**J.S. HELD, LLC
#6 MEADOW HEIGHTS PROFESSIONAL PARK
COLLINSVILLE, ILLINOIS 62234
(618) 343-3590**

JANUARY 2023

DOCUMENT TO BE RETAINED INDEFINITELY

TABLE OF CONTENTS

23-0-448
Drinking Water Sampling for Lead
Wentzville R-IV School District
Admin Center
280 Interstate Dr.
Wentzville, Missouri 63385

EXECUTIVE SUMMARY

APPENDIX A Sample Locations/Results

APPENDIX B Laboratory Analysis

APPENDIX C Credentials

EXECUTIVE SUMMARY

December 28, 2023

Mrs. Angela Hawkins
Director of Maintenance
Wentzville R-IV School District
101 Support Service Drive
O'Fallon, Missouri 63366

Subject: Results of Drinking Water Testing for Lead Content

**Site(s): Admin Center
280 Interstate Drive
Wentzville, MO 63385**

Dear Mrs. Hawkins,

On the morning of December 14th, 2023, J.S. Held, LLC performed lead testing of multiple water sources at the Admin Center located at 280 Interstate Drive in Wentzville, Missouri. The sampling was performed by trained and licensed personnel in accordance with USEPA, HUD and State of Missouri Regulations and Guidelines. Work was performed in accordance with the newly amended Missouri Senate Bill 681.

All inspectors involved with sampling activities had EPA approved training in lead. Certifications for our firm and the inspector collecting the samples are included as Appendix C to this document.

All samples were collected on a “first draw” and “second draw” basis. “First draw” is achieved by allowing the water system to rest for at least eight hours prior to sampling in order to collect any existing debris or settlement within the sample. The intent of this sampling is to replicate “worst case scenario” conditions. J.S. Held proposes to collect a second sample from each source as a “follow-up sample” per the Missouri Senate Bill 681 requirements. As such, J.S. Held inspector met at the building at 5:30 a.m. to collect water samples before the systems were used by staff or students. The State of Missouri and other regulatory agencies recommend that water sources run for at least thirty seconds and as long as two minutes prior to use to avoid settling within the water system.

Drinking water samples were collected from Fifteen (15) different locations throughout Admin Center during the sampling event. The water samples were collected from drinking fountains and sinks potentially utilized for cooking or drinking activities at the campus. After sample collection, samples were immediately iced down and delivered to Teklab, Inc. located in Collinsville, Illinois following strict chain of custody procedures. Teklab is a NELAP accredited and State of Illinois licensed laboratory specializing in drinking water analysis. Detailed sampling locations and sample results are located in Appendix A of this report.

The analytical sensitivity utilized for the analysis of the water samples submitted identified a reporting limit (RL) of 1.0 micrograms per liter ($\mu\text{g/L}$). The analytical sensitivity utilized for the analysis of the water samples submitted identified a reporting limit (RL) of 1.0 microgram of lead per liter ($\mu\text{g/L}$). This reporting value equates to 1.0 parts per billion (ppb) of lead. The USEPA action level for lead in drinking water is 15.0 ppb for PSW. The USEPA document titled "Lead in Drinking Water at Schools and Child Care Facilities" last updated November 9, 2015 identifies an action level for drinking water collected from a plumbing fixture as 20.0 ppb. **Twenty-Seven (27) samples collected from the selected locations at the Admin Center reported sample results which were less than the action level.** This information can be found under the National Primary Drinking Water Regulations provided by the EPA, CFR 2010 Title 40. (See Appendix A and B for Sample Results) The Missouri Senate Bill 1075 require potable plumbing fixtures to be less than 5.0 ppb, the levels area above 5 ppb, then action shall be necessary to filter the water from the fixture or clean/repair/replace the fixture and retest until the levels are reported below 5 ppb. **Six (6) samples collected from the selected locations at the Admin Center reported a sample result which is above 5 ppb** (See Appendix A and B for Sample Results)

The following results are greater than the 5 ppb requirements under Senate Bill 681.

Sample ID 07A Room 251 – Sink	(18.7 ppb)
Sample ID 12B Room 451 Near Room 453 – Sink	(6.1 ppb)
Sample ID 13A Room 451 Near Room 455 – Sink	(12.1 ppb)
Sample ID 14A Room 310 – Sink	(11.1 ppb)
Sample ID 15A Room 341 – Sink	(8.3 ppb)
Sample ID 16A Room 260 – Sink	(30.8 ppb)

At this time all water sources testing at 5 ppb or above should be removed from service until filtration can be added or these sources are repaired/replaced and retested reporting under 5 ppb. These sources are subject to additional maintenance activities and response actions prior to use. Before being put back in service. In addition, all sources will be subject to an ongoing maintenance program and re-testing at appropriate intervals. **The district will be required to provide notification to parents and staff within 7 days of**

receiving these sample results and results shall be posted on the district website within 2 weeks. Any samples reported over 5 ppb should be re-sampled on an annual basis at a minimum.

J.S. Held recommends that all water sources run for at least thirty seconds prior to use as recommended by the USEPA.

J.S. Held is pleased to provide this information to Wentzville R-IV School District and we appreciate the opportunity to provide quality environmental consulting services. Please call us at (618) 343-3590 if you have any questions or to arrange a meeting to discuss.

Sincerely,
J.S. Held, LLC

Jim Yasitis

Jim Yasitis
Vice President of Environmental Health & Safety

APPENDIX A

SAMPLE LOCATIONS & RESULTS

TABLE 1

**Drinking Water Sampling for Lead Content
Wentzville R-IV School District
Admin Center Building
Sampled: December 14, 2023**

Sample ID	Location	Water Source	Results (ppb)
01A	Room 125 – North Wall	Sink	3.2
01B	Room 125 – North Wall	Sink	<1.0
02A	Room 125 – South Wall	Sink	4.8
02B	Room 125 – South Wall	Sink	<1.0
03	Room 125	Ice Machine	<1.0
04A	Near Room 275	Fountain	<1.0
04B	Near Room 275	Fountain	<1.0
05A	Near Room 200 (Left)	Fountain	<1.0
05B	Near Room 200 (Left)	Fountain	<1.0
06A	Near Room 200 (Right)	Fountain	<1.0
06B	Near Room 200 (Right)	Fountain	<1.0
07A	Room 251	Sink	18.7
07B	Room 251	Sink	2.1
08A	Near Room 406 (Left) Non-Functional	Fountain	--
08B	Near Room 406 (Left) Non-Functional	Fountain	--
09A	Near Room 406 (Right)	Fountain	<1.0
09B	Near Room 406 (Right)	Fountain	<1.0
10A	Near Room 460	Fountain	1.3
10B	Near Room 460	Fountain	1.8
11A	Near Room 407	Sink	1.2
11B	Near Room 407	Sink	<1.0
12A	Room 451 Near Room 453	Sink	6.1
12B	Room 451 Near Room 453	Sink	1.6
13A	Room 451 Near Room 455	Sink	12.2
13B	Room 451 Near Room 455	Sink	3.5
14A	Room 310	Sink	11.1
14B	Room 310	Sink	1.2
15A	Room 341	Sink	8.3
15B	Room 341	Sink	1.6
16A	Room 260	Sink	30.8
16B	Room 260	Sink	3.0

#####

Water sources in excess of 20 ppb. Recommendation is to remove from service immediately. Do not return to service until re-testing confirms mitigation was effective.

#####

Water source is 5-19.9 ppb, but still displays evidence of lead. Recommendation is to re-test source on an annual basis at a minimum.



Sample Legend

“A” = First Draw

“B” = Second Draw

WSD ADMINISTRATIVE CENTER

280 Interstate Drive, Wentzville, MO

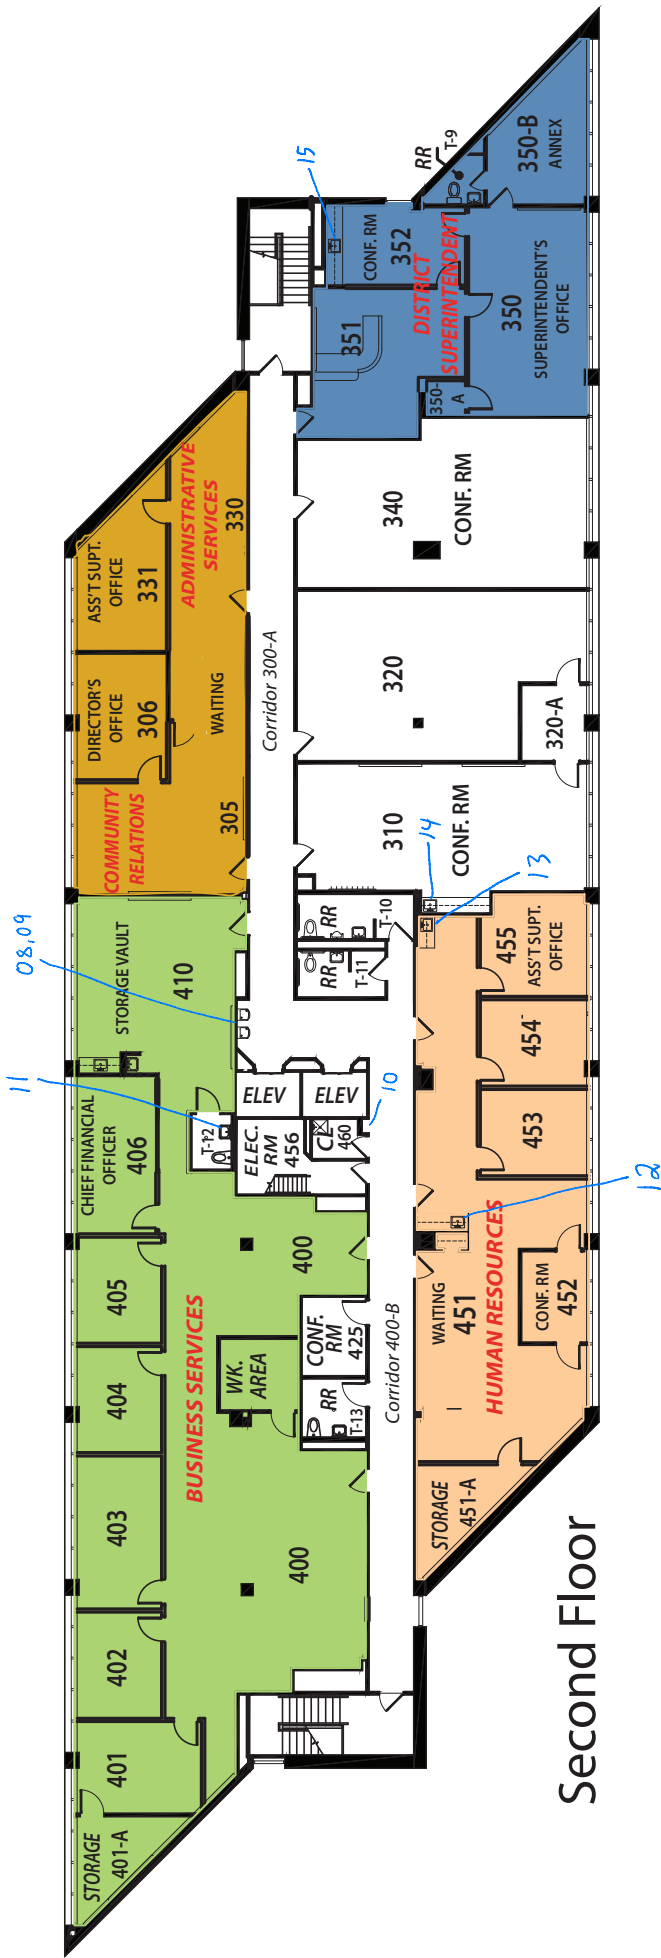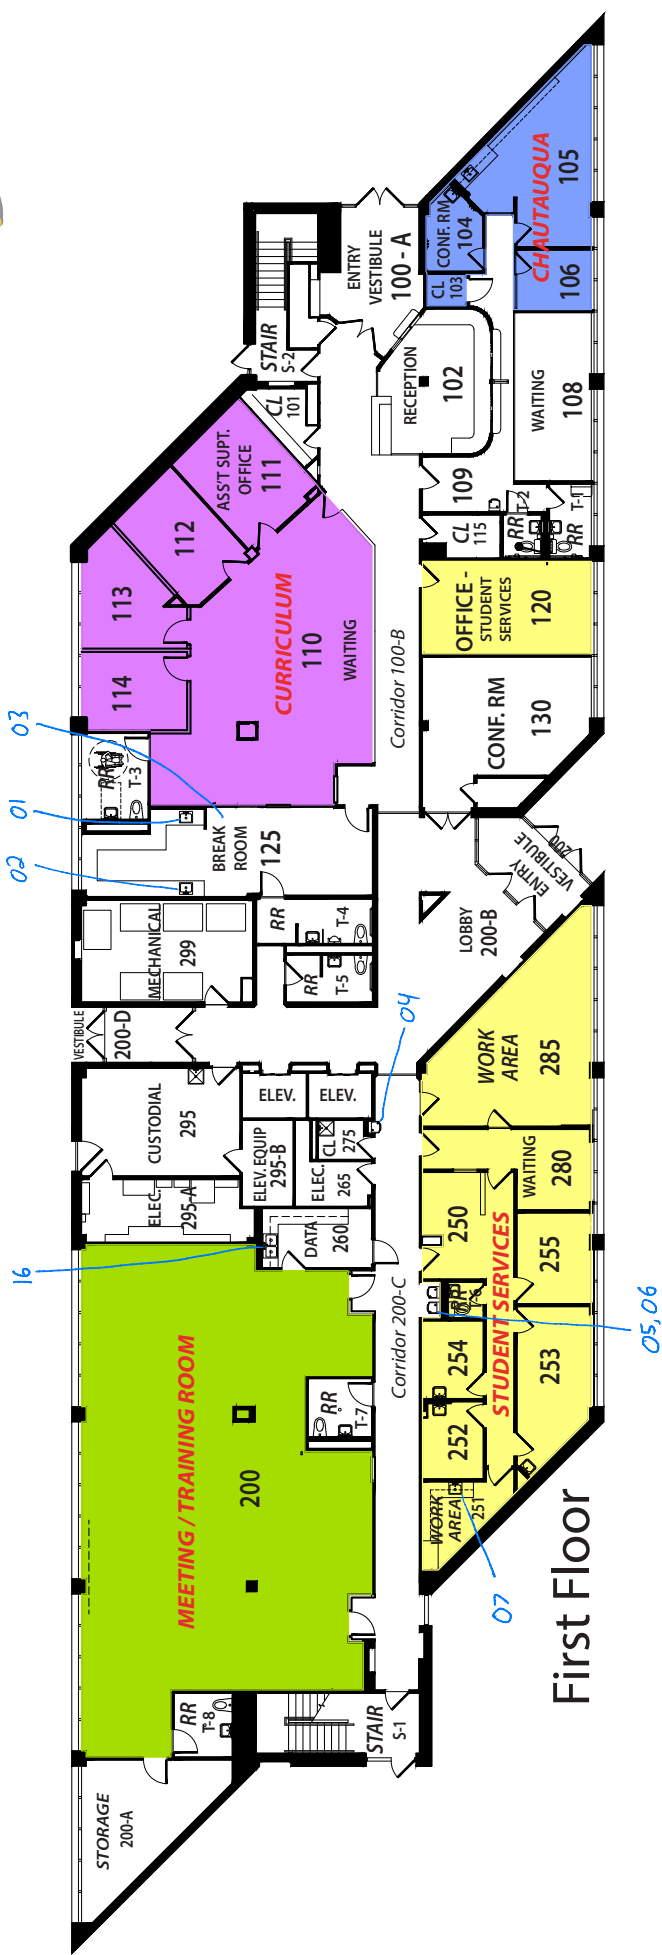

APPENDIX B

LABORATORY ANALYSIS

December 27, 2023

Jeff Faust
J.S. Held
#6 Meadow Heights Professional Park
Collinsville, IL 62234
TEL: (618) 343-3590
FAX: (618) 343-3597



Illinois	100226
Kansas	E-10374
Louisiana	05002
Louisiana	05003
Oklahoma	9978

RE: Wentzville SD Water Sampling 231000104

WorkOrder: 23121113

Dear Jeff Faust:

TEKLAB, INC received 29 samples on 12/14/2023 8:51:00 AM for the analysis presented in the following report.

Samples are analyzed on an as received basis unless otherwise requested and documented. The sample results contained in this report relate only to the requested analytes of interest as directed on the chain of custody. NELAP accredited fields of testing are indicated by the letters NELAP under the Certification column. Unless otherwise documented within this report, Teklab Inc. analyzes samples utilizing the most current methods in compliance with 40CFR. All tests are performed in the Collinsville, IL laboratory unless otherwise noted in the Case Narrative.

All quality control criteria applicable to the test methods employed for this project have been satisfactorily met and are in accordance with NELAP except where noted. The following report shall not be reproduced, except in full, without the written approval of Teklab, Inc.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Marvin L. Darling
Project Manager
(618)344-1004 ex 41
mdarling@teklabinc.com



Report Contents

<http://www.teklabinc.com/>

Client: J.S. Held

Work Order: 23121113

Client Project: Wentzville SD Water Sampling 231000104

Report Date: 27-Dec-23

This reporting package includes the following:

Cover Letter	1
Report Contents	2
Definitions	3
Case Narrative	5
Accreditations	6
Laboratory Results	7
Receiving Check List	8
Chain of Custody	Appended

Client: J.S. Held**Work Order:** 23121113**Client Project:** Wentzville SD Water Sampling 231000104**Report Date:** 27-Dec-23**Abbr Definition**

* Analytes on report marked with an asterisk are not NELAP accredited

CCV Continuing calibration verification is a check of a standard to determine the state of calibration of an instrument between recalibration.

CRQL A Client Requested Quantitation Limit is a reporting limit that varies according to customer request. The CRQL may not be less than the MDL.

DF Dilution factor is the dilution performed during analysis only and does not take into account any dilutions made during sample preparation. The reported result is final and includes all dilution factors.

DNI Did not ignite

DUP Laboratory duplicate is a replicate aliquot prepared under the same laboratory conditions and independently analyzed to obtain a measure of precision.

ICV Initial calibration verification is a check of a standard to determine the state of calibration of an instrument before sample analysis is initiated.

IDPH IL Dept. of Public Health

LCS Laboratory control sample is a sample matrix, free from the analytes of interest, spiked with verified known amounts of analytes and analyzed exactly like a sample to establish intra-laboratory or analyst specific precision and bias or to assess the performance of all or a portion of the measurement system.

LCSD Laboratory control sample duplicate is a replicate laboratory control sample that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MBLK Method blank is a sample of a matrix similar to the batch of associated sample (when available) that is free from the analytes of interest and is processed simultaneously with and under the same conditions as samples through all steps of the analytical procedures, and in which no target analytes or interferences should present at concentrations that impact the analytical results for sample analyses.

MDL "The method detection limit is defined as the minimum measured concentration of a substance that can be reported with 99% confidence that the measured concentration is distinguishable from method blank results."

MS Matrix spike is an aliquot of matrix fortified (spiked) with known quantities of specific analytes that is subjected to the entire analytical procedures in order to determine the effect of the matrix on an approved test method's recovery system. The acceptable recovery range is listed in the QC Package (provided upon request).

MSD Matrix spike duplicate means a replicate matrix spike that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MW Molecular weight

NC Data is not acceptable for compliance purposes

ND Not Detected at the Reporting Limit

NELAP NELAP Accredited

PQL Practical quantitation limit means the lowest level that can be reliably achieved within specified limits of precision and accuracy during routine laboratory operation conditions.

RL The reporting limit the lowest level that the data is displayed in the final report. The reporting limit may vary according to customer request or sample dilution. The reporting limit may not be less than the MDL.

RPD Relative percent difference is a calculated difference between two recoveries (ie. MS/MSD). The acceptable recovery limit is listed in the QC Package (provided upon request).

SPK The spike is a known mass of target analyte added to a blank sample or sub-sample; used to determine recovery deficiency or for other quality control purposes.

Surr Surrogates are compounds which are similar to the analytes of interest in chemical composition and behavior in the analytical process, but which are not normally found in environmental samples.

TIC Tentatively identified compound: Analytes tentatively identified in the sample by using a library search. Only results not in the calibration standard will be reported as tentatively identified compounds. Results for tentatively identified compounds that are not present in the calibration standard, but are assigned a specific chemical name based upon the library search, are calculated using total peak areas from reconstructed ion chromatograms and a response factor of one. The nearest Internal Standard is used for the calculation. The results of any TICs must be considered estimated, and are flagged with a "T". If the estimated result is above the calibration range it is flagged "ET"

TNTC Too numerous to count (> 200 CFU)

Client: J.S. Held

Work Order: 23121113

Client Project: Wentzville SD Water Sampling 231000104

Report Date: 27-Dec-23

Qualifiers

- | | |
|---|--|
| # - Unknown hydrocarbon | B - Analyte detected in associated Method Blank |
| C - RL shown is a Client Requested Quantitation Limit | E - Value above quantitation range |
| H - Holding times exceeded | I - Associated internal standard was outside method criteria |
| J - Analyte detected below quantitation limits | M - Manual Integration used to determine area response |
| ND - Not Detected at the Reporting Limit | R - RPD outside accepted recovery limits |
| S - Spike Recovery outside recovery limits | T - TIC(Tentatively identified compound) |
| X - Value exceeds Maximum Contaminant Level | |



Case Narrative

<http://www.teklabinc.com/>

Client: J.S. Held

Work Order: 23121113

Client Project: Wentzville SD Water Sampling 231000104

Report Date: 27-Dec-23

Cooler Receipt Temp: NA °C

Locations

Collinsville

Address 5445 Horseshoe Lake Road
Collinsville, IL 62234-7425
Phone (618) 344-1004
Fax (618) 344-1005
Email jhriley@teklabinc.com

Collinsville Air

Address 5445 Horseshoe Lake Road
Collinsville, IL 62234-7425
Phone (618) 344-1004
Fax (618) 344-1005
Email EHurley@teklabinc.com

Springfield

Address 3920 Pintail Dr
Springfield, IL 62711-9415
Phone (217) 698-1004
Fax (217) 698-1005
Email KKlostermann@teklabinc.com

Chicago

Address 1319 Butterfield Rd.
Downers Grove, IL 60515
Phone (630) 324-6855
Fax
Email arenner@teklabinc.com

Kansas City

Address 8421 Nieman Road
Lenexa, KS 66214
Phone (913) 541-1998
Fax (913) 541-1998
Email jhriley@teklabinc.com

Client: J.S. Held**Work Order:** 23121113**Client Project:** Wentzville SD Water Sampling 231000104**Report Date:** 27-Dec-23

State	Dept	Cert #	NELAP	Exp Date	Lab
Illinois	IEPA	100226	NELAP	1/31/2024	Collinsville
Kansas	KDHE	E-10374	NELAP	4/30/2024	Collinsville
Louisiana	LDEQ	05002	NELAP	6/30/2024	Collinsville
Louisiana	LDEQ	05003	NELAP	6/30/2024	Collinsville
Oklahoma	ODEQ	9978	NELAP	8/31/2024	Collinsville
Arkansas	ADEQ	88-0966		3/14/2024	Collinsville
Illinois	IDPH	17584		5/31/2025	Collinsville
Iowa	IDNR	430		6/1/2024	Collinsville
Kentucky	UST	0073		1/31/2024	Collinsville
Missouri	MDNR	00930		5/31/2023	Collinsville
Missouri	MDNR	930		1/31/2025	Collinsville



Laboratory Results

<http://www.teklabinc.com/>

Client: J.S. Held

Work Order: 23121113

Client Project: Wentzville SD Water Sampling 231000104

Report Date: 27-Dec-23

Matrix: DRINKING WATER

Sample ID	Client Sample ID	Certification	Qual	RL	Result	Units	DF	Date Analyzed	Date Collected
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)									
Lead									
23121113-001A	01A	NELAP		1.0	3.2	µg/L	1	12/19/2023 11:53	12/14/2023 5:30
23121113-002A	01B	NELAP		1.0	< 1.0	µg/L	1	12/19/2023 11:57	12/14/2023 5:30
23121113-003A	02A	NELAP		1.0	4.8	µg/L	1	12/19/2023 12:00	12/14/2023 5:30
23121113-004A	02B	NELAP		1.0	< 1.0	µg/L	1	12/19/2023 12:04	12/14/2023 5:30
23121113-005A	03	NELAP		1.0	< 1.0	µg/L	1	12/19/2023 12:08	12/14/2023 5:30
23121113-006A	04A	NELAP		1.0	< 1.0	µg/L	1	12/19/2023 12:30	12/14/2023 5:30
23121113-007A	04B	NELAP		1.0	< 1.0	µg/L	1	12/19/2023 12:34	12/14/2023 5:30
23121113-008A	05A	NELAP		1.0	< 1.0	µg/L	1	12/19/2023 12:37	12/14/2023 5:30
23121113-009A	05B	NELAP		1.0	< 1.0	µg/L	1	12/19/2023 12:41	12/14/2023 5:30
23121113-010A	06A	NELAP		1.0	< 1.0	µg/L	1	12/19/2023 12:45	12/14/2023 5:30
23121113-011A	06B	NELAP		1.0	< 1.0	µg/L	1	12/19/2023 12:48	12/14/2023 5:30
23121113-012A	07A	NELAP		1.0	18.7	µg/L	1	12/19/2023 12:52	12/14/2023 5:30
23121113-013A	07B	NELAP		1.0	2.1	µg/L	1	12/19/2023 12:56	12/14/2023 5:30
23121113-014A	09A	NELAP		1.0	< 1.0	µg/L	1	12/19/2023 13:00	12/14/2023 5:30
23121113-015A	09B	NELAP		1.0	< 1.0	µg/L	1	12/19/2023 13:03	12/14/2023 5:30
23121113-016A	10A	NELAP		1.0	1.3	µg/L	1	12/19/2023 13:26	12/14/2023 5:30
23121113-017A	10B	NELAP		1.0	1.8	µg/L	1	12/19/2023 13:29	12/14/2023 5:30
23121113-018A	11A	NELAP		1.0	1.2	µg/L	1	12/19/2023 13:33	12/14/2023 5:30
23121113-019A	11B	NELAP		1.0	< 1.0	µg/L	1	12/19/2023 13:37	12/14/2023 5:30
23121113-020A	12A	NELAP		1.0	6.1	µg/L	1	12/20/2023 15:19	12/14/2023 5:30
23121113-021A	12B	NELAP		1.0	1.6	µg/L	1	12/19/2023 10:39	12/14/2023 5:30
23121113-022A	13A	NELAP		1.0	12.2	µg/L	1	12/19/2023 10:53	12/14/2023 5:30
23121113-023A	13B	NELAP		1.0	3.5	µg/L	1	12/19/2023 10:57	12/14/2023 5:30
23121113-024A	14A	NELAP		1.0	11.1	µg/L	1	12/19/2023 11:01	12/14/2023 5:30
23121113-025A	14B	NELAP		1.0	1.2	µg/L	1	12/19/2023 11:05	12/14/2023 5:30
23121113-026A	15A	NELAP		1.0	8.3	µg/L	1	12/19/2023 11:16	12/14/2023 5:30
23121113-027A	15B	NELAP		1.0	1.6	µg/L	1	12/19/2023 11:19	12/14/2023 5:30
23121113-028A	16A	NELAP		1.0	30.8	µg/L	1	12/19/2023 11:23	12/14/2023 5:30
23121113-029A	16B	NELAP		1.0	3.0	µg/L	1	12/18/2023 21:07	12/14/2023 5:30



Receiving Check List

<http://www.teklabinc.com/>

Client: J.S. Held

Work Order: 23121113

Client Project: Wentzville SD Water Sampling 231000104

Report Date: 27-Dec-23

Carrier: Brad Frisch

Received By: HAW

Completed by:

On:

14-Dec-23

Mary E Kemp

Reviewed by:

On:

14-Dec-23

Ellie Hopkins

Pages to follow:

Chain of custody

4

Extra pages included

2

Shipping container/cooler in good condition?

Yes ☒

No ☐

Not Present ☐

Temp °C

NA

Type of thermal preservation?

None ☒

Ice ☐

Blue Ice ☐

Dry Ice

☐

Chain of custody present?

Yes ☒

No ☐

Chain of custody signed when relinquished and received?

Yes ☒

No ☐

Chain of custody agrees with sample labels?

Yes ☒

No ☐

Samples in proper container/bottle?

Yes ☒

No ☐

Sample containers intact?

Yes ☒

No ☐

Sufficient sample volume for indicated test?

Yes ☒

No ☐

All samples received within holding time?

Yes ☒

No ☐

Reported field parameters measured:

Field ☐

Lab ☐

NA ☒

Container/Temp Blank temperature in compliance?

Yes ☒

No ☐

When thermal preservation is required, samples are compliant with a temperature between 0.1°C - 6.0°C, or when samples are received on ice the same day as collected.

Water – at least one vial per sample has zero headspace?

Yes ☐

No ☐

No VOA vials ☒

Water - TOX containers have zero headspace?

Yes ☐

No ☐

No TOX containers ☒

Water - pH acceptable upon receipt?

Yes ☒

No ☐

NA ☐

NPDES/CWA TCN interferences checked/treated in the field?

Yes ☐

No ☐

NA ☒

Any No responses must be detailed below or on the COC.

Samples were checked for turbidity and then preserved with nitric acid upon arrival in the laboratory.

TEKLALAB, INC. 5445 Horseshoe Lake Road ~ Collinsville, IL 62234 ~ Phone: (618) 344-1004 ~ Fax: (618) 344-1005

Client: J.S. Held
Address: 6 Meadow Heights Prof Park
City / State / Zip: Collinsville, IL 62234
Contact: Jim Yasitis Phone: 618-343-3590
E-Mail: james.yasitis@jsheld.com Fax: 618-343-3597

◦ Are these samples known to be involved in litigation? If yes, a surcharge will apply. ☐ Yes ☒ No

◦ Are these samples known to be hazardous? ☐ Yes ☒ No

◦ Are there any required reporting limits to be met on the requested analysis? If yes, please provide limits in comment section. ☒ Yes ☐ No

[illegible]

The individual signing this agreement on behalf of client acknowledges that he/she has read and understands the terms and conditions of this agreement, on the reverse side, and that he/she has the authority to sign on behalf of client.

WHITE-LABEL CANNED TUNA

CHAIN OF CUSTODY

pg. 3 of 4 Work Order # 2312112

TEKLAB, INC. 5445 Horseshoe Lake Road ~ Collinsville, IL 62234 ~ Phone: (618) 344-1004 ~ Fax: (618) 344-1005

Client: J. S. Held
 Address: 6 Meadow Heights Prof Park
 City / State / Zip: Collinsville, IL 62234
 Contact: Jim Kasitis Phone: 618-343-3590
 E-Mail: james.kasitis@jsheld.com Fax: 618-343-3597

- Are these samples known to be involved in litigation? If yes, a surcharge will apply. ☐ Yes ☒ No
- Are these samples known to be hazardous? ☐ Yes ☒ No
- Are there any required reporting limits to be met on the requested analysis? If yes, please provide limits in comment section. ☒ Yes ☐ No

Samples on: ☐ Ice ☐ Blue Ice ☐ No Ice ☐ °C
 Preserved in: ☐ Lab ☐ Field ☐ FOR LAB USE ONLY
 Lab Notes:
 Comments: Admin Center
Please report in ppb.

Project Name / Number		Sample Collector's Name		INDICATE ANALYSIS REQUESTED												
Wentville SD Water Sampling		Brad Frisch														
Results Requested	Billing Instructions	# and Type of Containers														
Standard <input type="checkbox"/> 1-2 Day (100% Surcharge) <input type="checkbox"/> Other <input type="checkbox"/> 3 Day (50% Surcharge)	Date/Time Sampled	UNPRMS	HNO ₃	NaOH	H ₂ SO ₄	HCL	MeOH	NaHSO ₄	Other	Water	Drinking Water	Soil	Sludge	Sp. Waste	X Lead (Pb)	
021	11B	X									X					
022	12A															
023	12B															
024	13A															
025	13B															
026	14A															
027	14B															
028	15A															
029	15B															
030	16A															
Relinquished By		Date / Time		Received By										Date / Time		
Brad Frisch		12-14-23 8:51A		A. Solwe										12-14-23 8:51		

The individual signing this agreement on behalf of client acknowledges that he/she has read and understands the terms and conditions of this agreement, on the reverse side, and that he/she has the authority to sign on behalf of client.

WHITE - LAB YFI 10101 CASHES 1010101

pg. 4 of 4 Work Order # 2321113

pg. 4 of 4 Work Order # 2321113

Client: J.S. Held
Address: 6 Meadow Heights Prof Park
City / State / Zip: Collinsville, IL 62234
Contact: Jim Kasitis Phone: 618-343-3590
E-Mail: james.kasitis@jsheld.com Fax: 618-343-3597

Samples on: ☐ Ice ☐ Blue Ice ☐ No Ice _____ °C
Preserved in: ☐ Lab ☐ Field FOR LAB USE ONLY
Lab Notes:

Comments: Admin Center

Please report in ppb.

- Are these samples known to be involved in litigation? If yes, a surcharge will apply. ☐ Yes ☒ No
- Are these samples known to be hazardous? ☐ Yes ☒ No
- Are there any required reporting limits to be met on the requested analysis? If yes, please provide limits in comment section. ☒ Yes ☐ No

[illegible]

The individual signing this agreement on behalf of client acknowledges that he/she has read and understands the terms and conditions of this agreement, on the reverse side, and that he/she has the authority to sign on behalf of client.

WYLLIE - LAURENCE

APPENDIX C

CREDENTIALS

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Bradley M. Frisch

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **3/1/2022**
Expiration Date: **3/1/2024**
License Number: **160229-300004900**



Paula F. Nickelson

Paula F. Nickelson
Acting Director
Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102

COLLEGE FOR
PUBLIC HEALTH & SOCIAL JUSTICE
SAINT LOUIS UNIVERSITY

CENTER FOR ENVIRONMENTAL EDUCATION AND TRAINING

verifies that

Brad Frisch

2668 Kettering Court, Saint Charles, MO 63303

has attended 8 contact hours of training and successfully passed an examination

Lead Risk Assessor Refresher

St. Louis, MO

Certificate # CEET 325 - 3/7/2022 - 117395

Examination Date: 3/7/2022


CEUs: 0.8

Certificate expiration is 3 years from examination date for Illinois Dept. of Public Health

Center for Environmental Education and Training, 3545 Lafayette, St. Louis, MO 63104

(314) 977-8256 slu.edu/x39753.xml

This training course has been accredited by the Illinois Department of Public Health, and by the Missouri Department of Health & Senior Services.

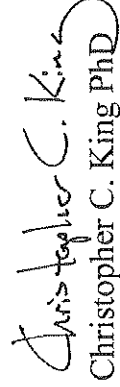
Christopher C. King PhD
Director, Center for Environmental
Education and Training

State of Missouri
Department of Natural Resources

Certificate of Approval
for Chemical Laboratory Service

This is to certify that

Teklab, Incorporated

is hereby approved to perform the analysis of drinking water as specified on the
Certified Parameter List, which must accompany this certificate to be valid.


Certification No. 930

Date Issued May 26, 2016


Expiration Date January 31, 2017



Chief, Public Drinking Water Branch
Water Protection Program
Department of Natural Resources

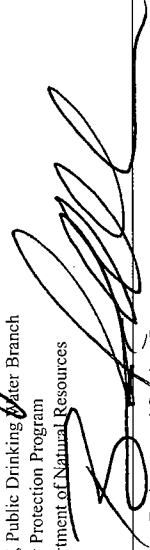

Director, Environmental Services Program
Department of Natural Resources



Evaluation Officer, Environmental Services Program
Department of Natural Resources

MISSOURI DEPARTMENT OF NATURAL RESOURCES

DRINKING WATER LABORATORY

CERTIFIED PARAMETER LIST

This is to certify that

Teklab, Incorporated

located at

5445 Horseshoe Lake Road, Collinsville, Illinois

has been approved to perform the indicated procedures on drinking water under the Missouri Public Drinking Water Regulations (10 CSR 60-5.020). Specific method numbers or references are included in parenthesis when appropriate.

METALS

EPA 200.7 – Aluminum, Barium, Beryllium, Cadmium, Calcium, Chromium, Copper, Iron, Magnesium, Manganese, Nickel, Silver, Sodium, Zinc;

EPA 200.8 – Aluminum, Antimony, Arsenic, Barium, Beryllium, Cadmium, Chromium, Copper, Lead, Manganese, Molybdenum, Nickel, Selenium, Silver, Thallium, Zinc;

EPA 245.1 – Mercury; ***SM 3112B*** – Mercury;

INORGANIC NONMETALLIC CONSTITUENTS

EPA 353.2 – Nitrate, Nitrite; ***SM 4500Cl-G*** – Residual Free Chlorine; ***SM 4500CN-E*** – Cyanide;

SM 4500F-C – Fluoride; ***SM 4500H+-B*** – pH; ***SM 4500NO2-B*** – Nitrite;

SM 4500P-E – Orthophosphate as P; ***SM 4500Si-E*** – Silica;

PHYSICAL & AGGREGATE PROPERTIES

SM 2120B – Color; ***SM 2130B*** – Turbidity; ***SM 2320B*** – Alkalinity; ***SM 2340B*** – Hardness;

SM 2340C – Hardness; ***SM 2510B*** – Conductivity; ***SM 2550B*** – Temperature;

EPA 180.1 – Turbidity;

AGGREGATE ORGANIC CONSTITUENTS

SM 5310C – Total Organic Carbon; ***SM 5310C*** – Dissolved Organic Carbon

Expiration Date: January 31, 2017

Missouri Certificate No.: 930

Original Certifying State: Illinois